


	<b>AQUAVAS S.A. VASLUI</b> <b>SUCURSALA HUȘI</b> RO-17986823 Str. Ștefan cel Mare, nr. 18 ROMANIA C.U.I. 27913802, Nr.inregistrare la R.C.: J37/13/2011 Cont: RO10 BRDE 380SV30767583800 deschis la B.R.D. Huși				
	Tel.: 0235 481560; 0235 481288	Fax: 0235 471268	E-mail: aquavas.husi@gmail.com		

74/04.10.2021

Locul prelevării - B-dul 1 Mai  
 Data /ora prelevării - 04.10.2021/h -8 :00  
 Tipul probei - Apa tratata  
 Proba a fost prelevata de - lab. Ciobanu Mihaiela  
 Punctul de prelevare - Rezervor consumator

DIRECTOR,  
 Ing. Branici Gigel

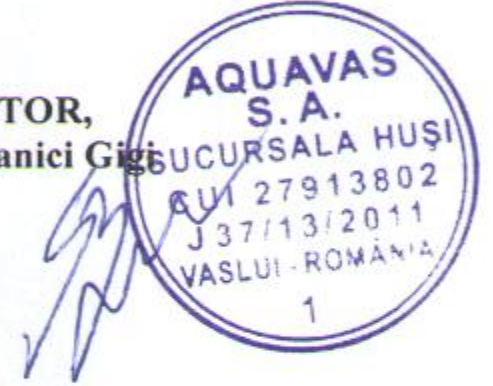

**REZULTATELE ANALIZELOR FIZICO-CHIMICE**

Nr. crt	Parametrul analizat	U.M	Valori obtinute	C.M.A Lg.458/2002(2011)	Metoda de analiza
1	Aluminiu	µg/l	120	200	SR ISO 10566/2001
2	Amoniu	mg/l	0.062	0,5	SR ISO7150-1/2001
3	Cloruri	mg/l	46,15	250	SR EN ISO9297 :2001
4	Clor rezidual liber	mg/l	0,19	>0,1<0,5	STAS 6364/78
5	Culoare	grad de culoare	Acce.	acceptabila consumatorilor	SR EN ISO 7887/2002
6	Gust	-	Acce.	Acceptabila consumatorilor	SR EN 1622/2007
7	Miros	-	-	-	SR EN 16622/2007
8	Oxidabilitate	mgO2/l	1.85	5	SR EN ISO 8467/2001
9	pH	Unitati pH	8,03	>6,5 :<9,5	SR ISO10523/2009
10	Turbiditate	UTF	0.68	<5	SR EN ISO7027/2001
11	Nitriti	mg/l	0.043	0,5	SR EN 26777/c 91/2006
12	Nitrati	mg/l	5.29	50	Sr iso 7890-3/2000
13	Conductivitate(20°C)	µs/cm	570	2500	SR EN27888/1997
14	Duritate totala	grad german	11,87	min.5	SR ISO6059/2008

Concluziile analizei :proba de apa analizata corespunde/ nu corespunde conf.  
 Legii458/2002privind calitatea apei potabile si lg. Modificata 311/2004

SEF LABORATOR,  
 Catargiu Andrea

LABORANT,  
 Ciobanu Mihaiela